


# INSTALLATION INSTRUCTIONS

## MODELS TS-2T, TS-3T, TS-4T, TS-5T



U.L. FILE SA32686

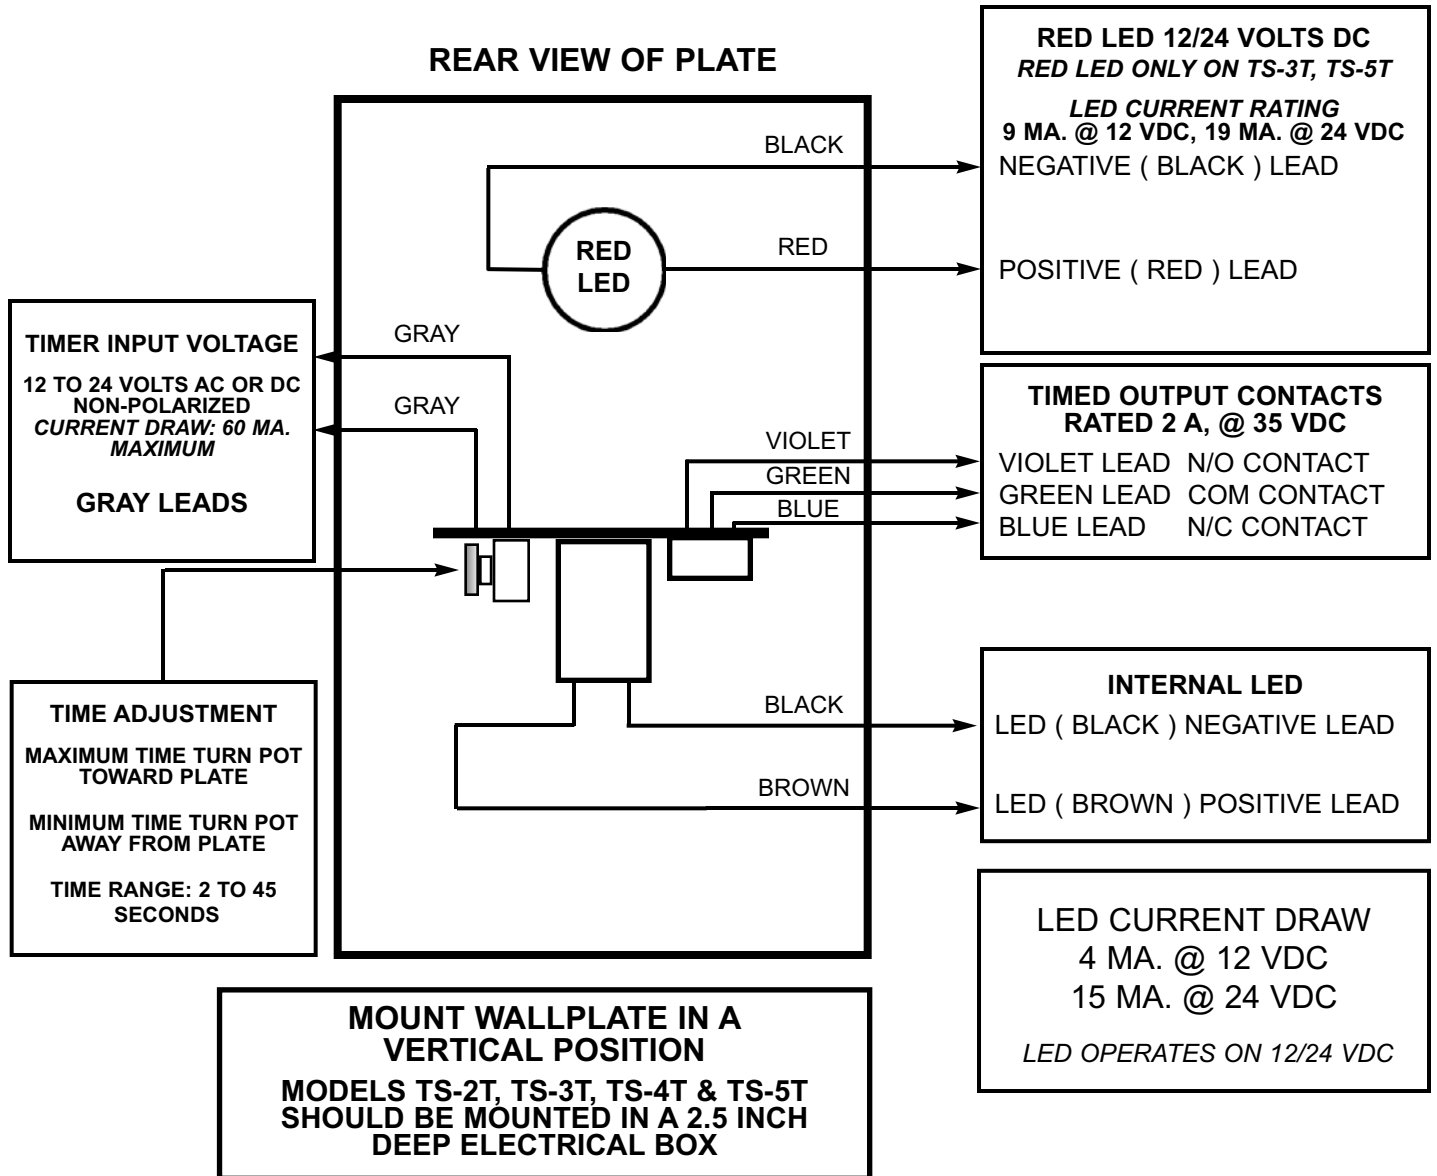


**NOTE:** TIMER WILL ACTIVATE WHEN **PUSH TO EXIT** SWITCH IS DEPRESSED.  
SUBSEQUENT DEPRESSIONS OF THE SWITCH WILL RE-START THE TIMER.



**ALARM CONTROLS CORPORATION**  
19 BRANDYWINE DRIVE P.O. BOX 280  
DEER PARK, NY 11729

PH: 1 800 645-5538 1 631 586-4220 FAX ; 1 631 586-6500  
WWW.ALARMCONTROLS.COM EMAIL: INFO@ALARMCONTROLS.COM

# TYPICAL WIRING DIAGRAMS FOR MODEL TS-2T

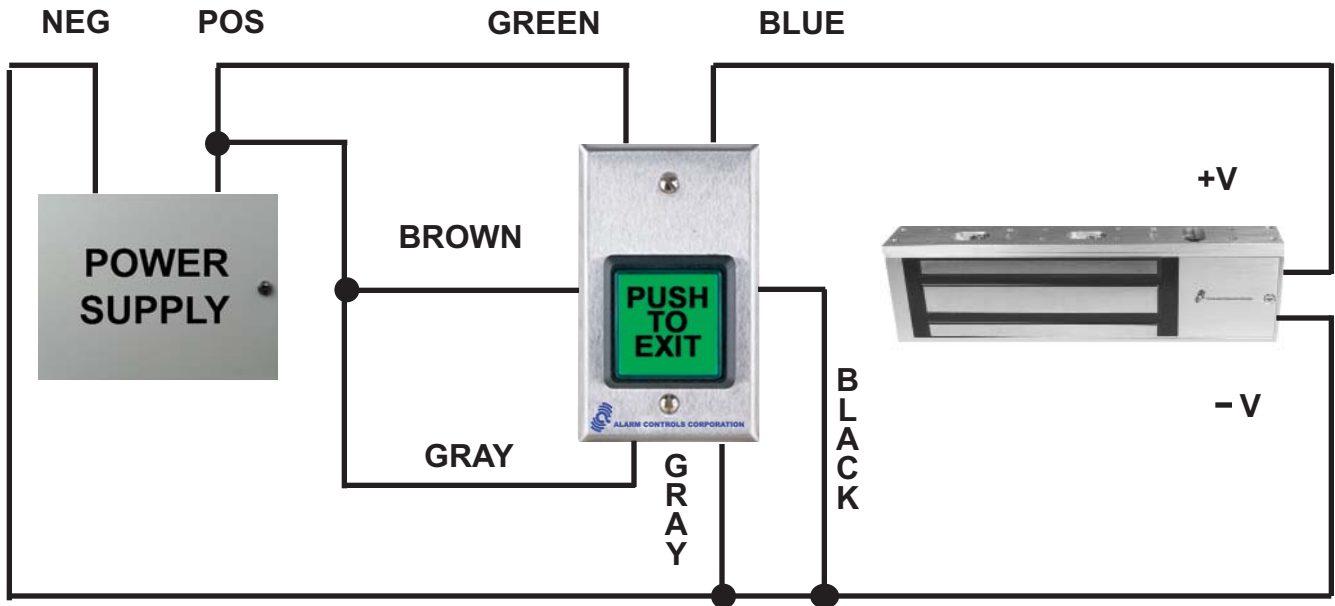

## ELECTRIC DOOR STRIKE FAIL SECURE MODE

